


Function		Loop Frequency Setting		
Dip Switch		Dip Switch		Loop Oscillation Frequency
#5	Relay A Function	#1	#2	
OFF	Presence on Loop A			
ON	Pulse on Loop A	OFF	OFF	High
#6	Relay A Pulse Type	ON	OFF	Mid High
OFF	Pulse on Loop A Entry	OFF	ON	Mid Low
ON	Pulse on Loop A Exit	ON	ON	Low
#7	Relay B Function			
OFF	Presence on Loop A			
ON	Pulse on Loop A			
#8	Relay B Pulse Type			
OFF	Pulse on Loop A Entry			
ON	Pulse on Loop A Exit			

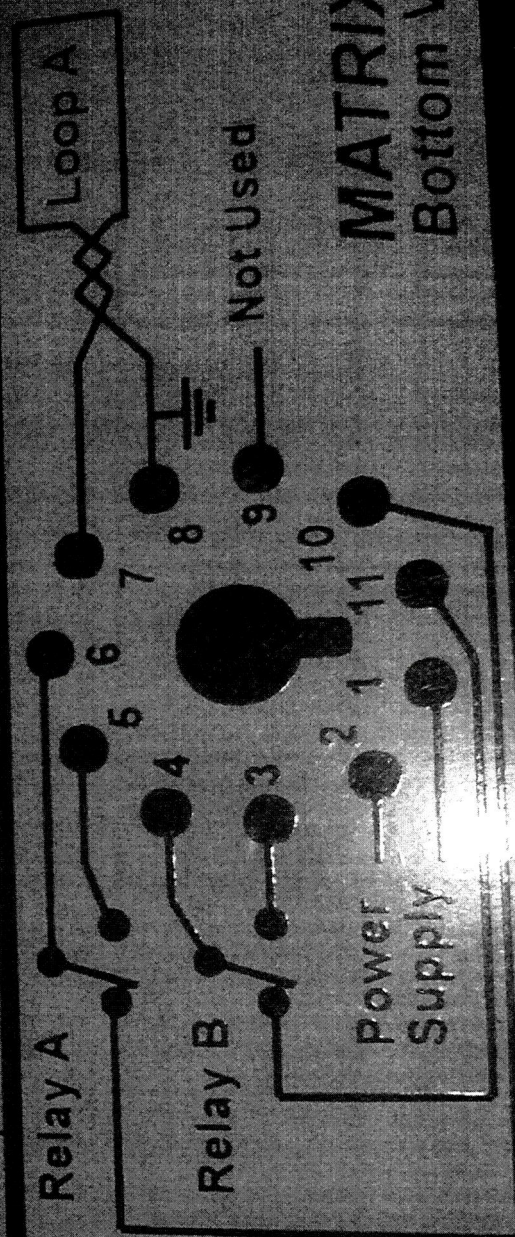

MATRIX-S
Bottom View

BEA

ALLEE DES NOISETIERS,5
B-4031 ANGLEUR BELGIUM
www.beasensors.com

CE 0650 

SEE MANUAL
FOR USE

 **UL** US


LISTED
1ED8
IND.CONT.EQ.

BEA


MATRIX-S-12-24

12-24V+-10% AC DC, 2.5VA
RELAY: 250V, 5A

PF 008278 KF

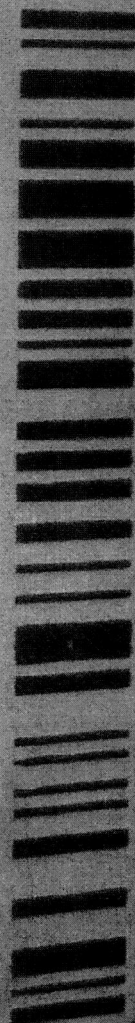

Power



Pres. Time Adj.
1 min to ∞

ON
1 2 3 4 5 6 7 8 9 10
APFMs

☐ Freq. Adjust.

Relay A,B : Act / -Pas

ASB

Relay A : Pres / Puls

Relay A : Entry / Exit


Relay B : Pres / Puls

Relay B : Entry / Exit

Pulse : 0,1s / 0,5s

Not Used

Detect



Loop sens. Adj.